

Test Report No. 7191080264-MEC14-ED
dated 16 Apr 2014



PSB Singapore

Choose certainty.
Add value.

Note: This report is issued subject to the Testing and Certification Regulations of the TÜV SÜD Group and the General Terms and Conditions of Business of TÜV SÜD PSB Pte Ltd. In addition, this report is governed by the terms set out within this report.

SUBJECT:

Testing of sealant

TESTED FOR:

Guangzhou Baiyun Chemical Industry Co., Ltd
No.1, Yunan Road
Guangzhou Civilian Science
Taihe, Guangzhou
China

Attn: Mr Loris Lee

SAMPLE DESCRIPTION:

The following items were received on 29 Jan 2014 as shown:

Sample	Size	Quantity
'SS818 Staining Resistant Silicone Sealant'	590 ml	16 sausages

TEST METHODS:

Adopted ASTM C920 : 2008 Standard Specification For Elastomeric Joint Sealants

Staining And Colour Change

1. ASTM C510 : 2005 Standard Test Method For Staining And Colour Change Of Single Or Multi-Component Joint Sealants

Test cycle : 8 hours UV exposure at 55°C and 4 hours condensation at 45°C
Exposure duration : 100 hours
No. of determination : 1 for staining test, 1 for colour change test, 1 as control

Extrudability

2. ASTM C1183 : 2008 Standard Test Method For Extrusion Rate Of Elastomeric Sealants
(Cross Reference: ASTM D1475 : 2008 Standard Test Method For Density Of Liquid Coatings, Inks And Related Products)

Apparatus : Pycnometer and caulking gun
Test pressure : 40 psi
No. of determination : 1



TÜV SÜD PSB

Laboratory:
TÜV SÜD PSB Pte. Ltd.
Testing Services
No.1 Science Park Drive
Singapore 118221

Phone : +65-6885 1333
Fax : +65-6776 8670
E-mail: testing@tuv-sud-psb.sg
www.tuv-sud-psb.sg
Co. Reg : 199002667R

Regional Head Office:
TÜV SÜD Asia Pacific Pte. Ltd.
3 Science Park Drive, #04-01/05
The Franklin, Singapore 118223
TUV®

Test Report No. 7191080264-MEC14-ED
dated 16 Apr 2014



PSB Singapore

Flow Properties

3. ASTM C639 : 2007 Standard Test Method For Rheological (Flow) Properties Of Elastomeric Sealants

Method : Test method for 'Type II' sealant
Test conditions : a) 4.4°C in environmental chamber for 4 hours
b) 50°C in oven for 4 hours
No. of determinations : 2 for vertical and horizontal displacements

Hardness

4. ASTM C661 : 2006 Standard Test Method For Indentation Hardness Of Elastomeric-Type Sealants By Means Of A Durometer

Test Conditions:

a) 23°C and 50% relative humidity for 7 days
b) 38°C and 95% relative humidity for 7 days
c) 23°C and 50% relative humidity for 7 days
No. of determinations : 2, 3 points per test piece

Tack-Free Time

5. ASTM C679 : 2003 Standard Test Method For Tack-Free Time Of Elastomeric Sealants

No. of determinations : 2

Cyclic Adhesion & Cohesion

6. ASTM C719 : 2005 Standard Test Method For Adhesion And Cohesion Of Elastomeric Joint Sealants Under Cyclic Movement (Hockman Cycle)

Test Conditions:

a) 23°C and 50% relative humidity for 7 days
b) 38°C and 95% relative humidity for 7 days
c) 23°C and 50% relative humidity for 7 days
d) Immersion in distilled water at 23°C for 7 days
e) Drying in oven at 70°C for 7 days

Cyclic Test Conditions:

Stage A-10 cycles of joint movements:

a) The joint width was compressed from 12.7mm to 6.4mm at 3.2 mm/h
b) It was extended from 6.4mm to 19.1mm at 3.2 mm/h
c) It was compressed again from 19.1mm to 12.7mm at 3.2 mm/h

Stage B-10 cycles of joint movements:

a) The joint width was compressed to 6.4mm and conditioned at 70°C for 16 to 20 hours
b) After ageing, the test specimens were cooled to 23°C for 2 to 3 hours
c) The joint width was extended to 19.1mm at -26°C and 3.2 mm/h
d) The specimens were removed and allowed to condition to room temperature

No. of determinations : 3 for Class 50

Test Report No. 7191080264-MEC14-ED
dated 16 Apr 2014



PSB Singapore

Effects Of Heat Ageing

7. ASTM C1246 : 2006 Standard Test Method For Effects Of Heat Ageing On Weight Loss, Cracking, And Chalking Of Elastomeric Sealants After Cure

Test Conditions:

- a) 23°C and 50% relative humidity for 28 days
b) 70°C for 21 days
No. of determinations : 3, 1 as control

Effects Of Accelerated Weathering

8. Adopted ASTM C793 : 2005 Standard Test Method For Effects Of Accelerated Weathering On Elastomeric Joint Sealants

Test cycle : 8 hours UV exposure at 55°C and 4 hours condensation at 45°C
Lamp designation : Fluorescent UVA 340 mm
Exposure duration : 250 hours
No. of determinations : 3 (1 as control)
Bend test
Apparatus : Steel mandrel
Test condition : -26°C for 24 hours
No. of determinations : 3

Adhesion-In-Peel

9. ASTM C794 : 2006 Standard Test Method For Adhesion-In-Peel Of Elastomeric Joint Sealants

Test Conditions:

- a) 23°C and 50% relative humidity for 7 days
b) 38°C and 95% relative humidity for 7 days
c) 23°C and 50% relative humidity for 7 days
d) Immersion in water at 23°C for 7 days
Crosshead speed : 50.8 mm/min
No. of determinations : 4

Material Identification/Verification

10. Material Identification/Verification By Fourier Transform Infra-Red Spectrometric Analysis (FTIR)

Ed

Test Report No. 7191080264-MEC14-ED
dated 16 Apr 2014



PSB Singapore

Staining

11. Adopted ASTM C1248 : 2008 Standard Test Method For Staining Of Porous Substrate By Joint Sealants
Cross-reference : ASTM G154 : 2006 Standard Practice For Operating Fluorescent Light Apparatus For UV Exposure Of Non-Metallic Materials

Test specimen : Adhesion & cohesion test assembly
 Test conditions : a. 23°C and 50% relative humidity for 21 days
 b. Adhesion/cohesion cyclic movement
 c. Before ageing, 14 and 28 days
 d. 70°C, 14 and 28 days
 e. UV exposure : 4 Hours UV at 60°C and 4 hours condensation at 50°C, 14 and 28 days
 No. of determinations : 20 sets per substrate, 4 sets per test condition

CONDITIONING:

Unless otherwise specified, all test specimens were tested at 23 ± 2°C and 65 ± 5% relative humidity.

TEST RESULTS:

Test	'SS818 Staining Resistant Silicone Sealant'	ASTM C920 : 2008 Standard Specification For Elastomeric Joint Sealants
1. Staining And Colour Change	No staining and no colour change	The sealant shall not cause any visible staining on the top surface of a white cement mortar base
2. Extrudability	>10 ml/min	Type S (single component), grade NS (non-sag or gunnable sealant) shall have an extrusion rate time of not < 10 ml/min
3. Rheological (Flow) Properties	Vertical displacement: 0 mm sag Horizontal displacement: No deformation	Grade NS (non-sag) or gunnable sealant shall have flow characteristics such that it does not sag >4.8mm in vertical displacement and shall show no deformation in horizontal displacement (refers to Types II and IV sealants)
4. Indentation Hardness test piece 1, average test piece 2, average	28 28	T (traffic) sealant shall have a hardness reading of not <25 or >50 after being properly cured NT (non-traffic) sealant shall have a hardness reading of not <15 or >50 after being properly cured
5. Tack-Free Time	No transfer of test specimens to the polyethylene film	There shall be no transfer of the sealant to the polyethylene film when tested at 72 hours
6. Adhesion & Cohesion Under Cyclic Movement, Class 50	No bond failure	The total loss in bond and cohesion areas among the three specimens tested for each surface shall not be >9 cm ² with mortar substrates
7. Effects Of Heat Ageing On Weight Loss, Cracking And Chalking, average	1.1% No cracking and chalking	The sealant shall not lose >7% of its original weight or show any cracking and chalking

Ed

Test Report No. 7191080264-MEC14-ED
dated 16 Apr 2014



PSB Singapore

TEST RESULTS:

Test	'SS818 Staining Resistant Silicone Sealant'	ASTM C920 : 2008 Standard Specification For Elastomeric Joint Sealants
8. Effects Of Accelerated Weathering	No cracks after UV exposure and bend test	The sealant shall show no cracks after the specified UV exposure and shall show no cracks after exposure at cold temperature and the bend test
9. Adhesion-In-Peel, average	46.5 N (10.5 lbf) cohesive failure within the sealant and no adhesive bond loss between sealant and substrate for each test piece	The peel strength for each individual test shall not be <22.2 N (5 lbf) and the sealant shall show no >25% adhesive bond loss for each individual test
10. Material Identification/ Verification By FTIR	Silicone-based material (refer to Figure 1)	-

TEST RESULTS:


Test	'SS818 Staining Resistant Silicone Sealant'
11. Staining a. Marble i. Before ageing, 14 days ii. Before ageing, 28 days iii. 70°C for 14 days iv. 70°C for 28 days v. UV exposure, 14 days vi. UV exposure, 28 days b. Granite i. Before ageing, 14 days ii. Before ageing, 28 days iii. 70°C for 14 days iv. 70°C for 28 days v. UV exposure, 14 days vi. UV exposure, 28 days	No surface stain No surface stain No surface stain No surface stain No surface stain No surface stain No surface stain No surface stain No surface stain No surface stain No surface stain No surface stain

REMARKS:

The test conditions for staining and colour change tests and effects of accelerated weathering test were adopted from ASTM G154 : 2006 Standard Practice For Operating Fluorescent Light Apparatus For UV Exposure Of Non-Metallic Materials.


Staining ASTM C1248

1. The marble and granite substrates, each of size 75 mm x 25 mm x 18 mm and primer were provided by TUV SUD PSB Pte Ltd as agreed by the client.
2. The primer was applied onto the substrates and allowed to dry till tack-free before application of the sealant.
3. The test samples for before ageing, 14 days test were used for before ageing, 28 days test.


Eddie Suwand
Senior Associate Engineer


Eng Aik How
Engineer
Building
Mechanical Centre

Figure 1 : IR spectrum of 'SS818 Staining Resistant Silicone Sealant'

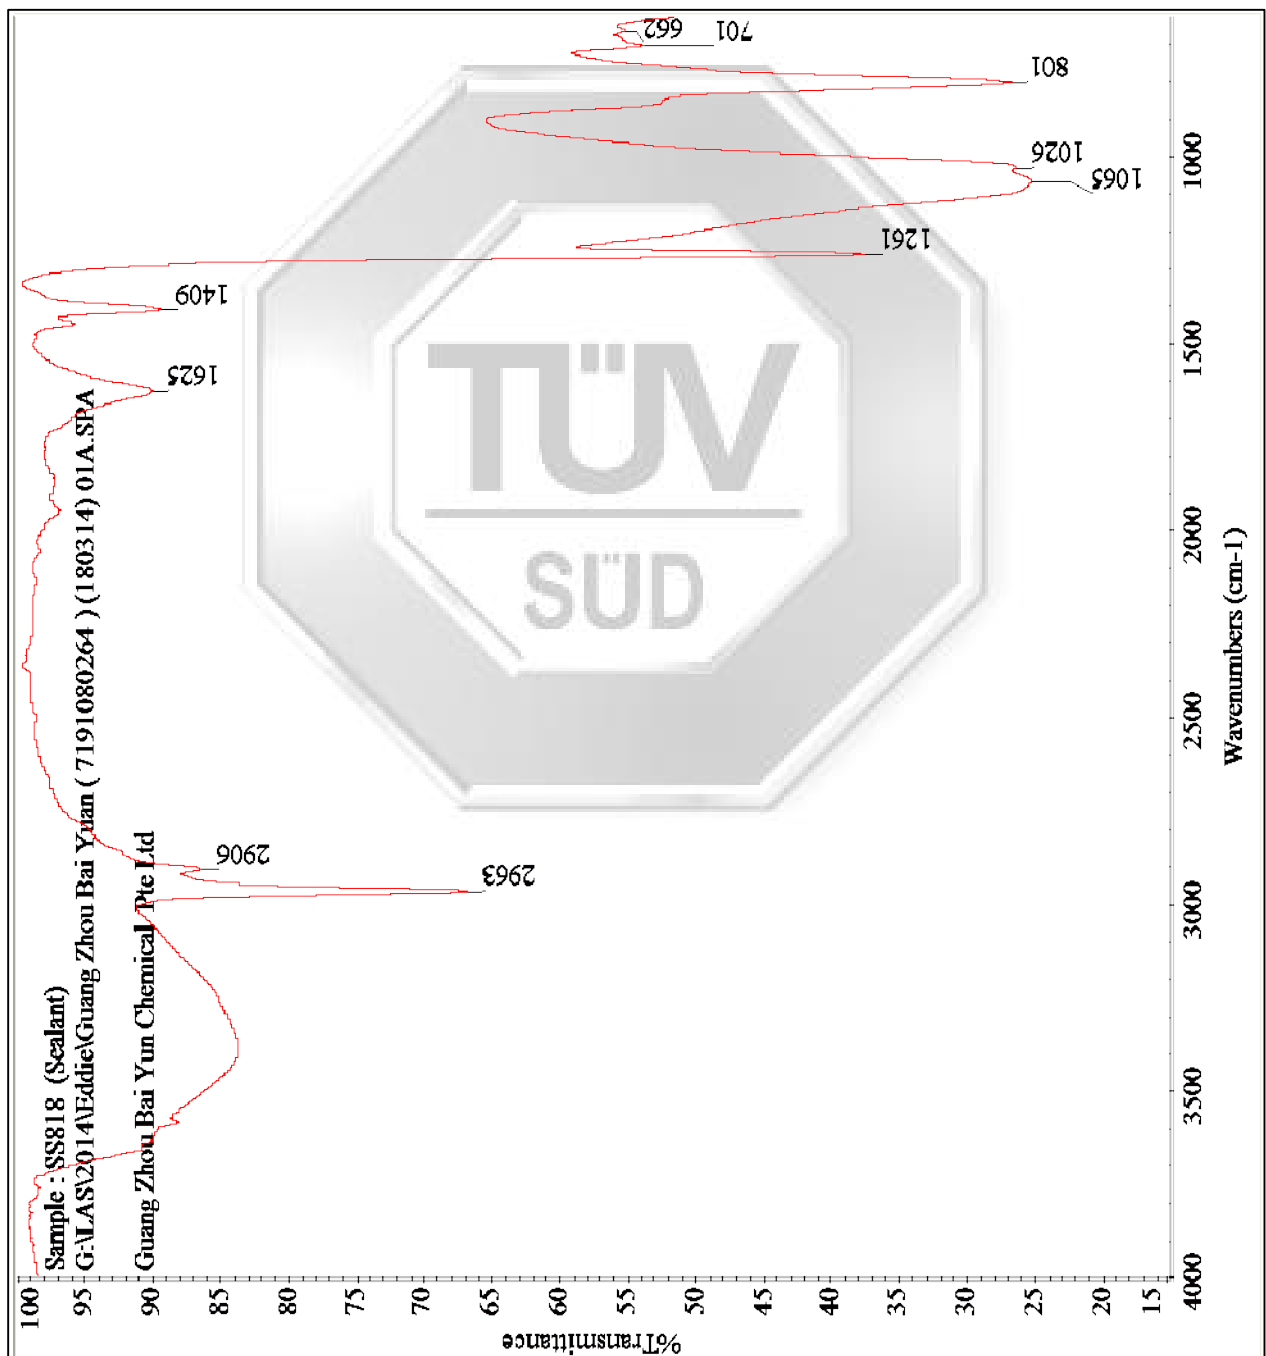

Test Report No. 7191080264-MEC14-ED
dated 16 Apr 2014



PSB Singapore

Please note that this Report is issued under the following terms :

1. This report applies to the sample of the specific product/equipment given at the time of its testing/calibration. The results are not used to indicate or imply that they are applicable to other similar items. In addition, such results must not be used to indicate or imply that TÜV SÜD PSB approves, recommends or endorses the manufacturer, supplier or user of such product/equipment, or that TÜV SÜD PSB in any way "guarantees" the later performance of the product/equipment. Unless otherwise stated in this report, no tests were conducted to determine long term effects of using the specific product/equipment.
2. The sample/s mentioned in this report is/are submitted/supplied/manufactured by the Client. TÜV SÜD PSB therefore assumes no responsibility for the accuracy of information on the brand name, model number, origin of manufacture, consignment or any information supplied.
3. Nothing in this report shall be interpreted to mean that TÜV SÜD PSB has verified or ascertained any endorsement or marks from any other testing authority or bodies that may be found on that sample.
4. This report shall not be reproduced wholly or in parts and no reference shall be made by the Client to TÜV SÜD PSB or to the report or results furnished by TÜV SÜD PSB in any advertisements or sales promotion.
5. Unless otherwise stated, the tests were carried out in TÜV SÜD PSB Pte Ltd, No.1 Science Park Drive Singapore 118221.

July 2011

